



V3-201 Specification Sheet

VIVREAU®



Please Read First

This Vivreau Water Dispenser is unlike any other water system you may have worked with and requires the following to install.

Electrical

Outlets

(1) 20amp electrical circuit GFCI recommended (5-20R) 120v, 60Hz (11 amps)

CO2 (Customer supplied)

Plumbing

Water Connection

1 potable ½” cold water supply terminating in a ½” ball valve with a ½” female pipe thread

Water Supply

- Minimum water pressure 50 PSI
- Minimum water flow 80 Gallons per hour

NOTE: Any incoming water temperature above 60°F will severely compromise the ability for the system to maintain a cold water supply

Drip Tray Drain (Optional)

A rigid vertical pipe that drains to a properly trapped drain according to local codes - must be at least 1 1/4” ID



Please refer to the rest of this document for further details regarding each specification. Contact Vivreau with any questions: +1 877 999 1044

Bottler North America V3-201 Specification Sheet

Product Dispensed:

Advanced micro-filtered, chilled still and sparkling water

Application:

For the purpose of filling Vivreau re-usable glass bottles

Equipment Dimensions:

- Width 23 3/8" Inches
- Depth 23 1/8" Inches
- Height 33 3/8" Inches (to top of cabinet height)
- 52 7/8" Inches (to top of dispense tap)

Please note that the system is installed as a floor-standing unit. Alternatively it can be installed as an under-counter system

The following services are required to be supplied by the customer and must be available prior to installation:

CO2

- CO2 - 20# canister (customer supplied) will fit inside unit, larger canisters can be connected externally (CO2 must be available for installation)
- *If connecting to a bulk or existing CO2 system a CO2 line terminating at a 1/4" barbed shutoff valve must be available within 40" of the Bottling System installation site, 100psi minimum pressure.

CO2 Supply
1/4" Barbed Shutoff



Electrical

- 1, 20amp electrical circuit (5-20 R) 120V 60Hz (11 amps)

Plumbing

- 1 potable 1/2" cold water supply terminating in a 1/2" ball valve, 1/2" female pipe thread. (ball valve must be accessible for service and installation).
*The Vivreau system incorporates back flow prevention, any additional back flow devices required by local or state code must also be supplied by the customer prior to installation. There should not be any other filters/pre-filters before the Vivreau system.

OPTIONAL: If the drip tray is to be plumbed to waste the customer needs to supply a rigid vertical pipe that drains to a properly trapped drain according to local codes. The vertical pipe for the drip tray drain must be located directly behind where the machine is to be installed and must be at least 1 1/4" ID.

Location of Services: (all services must be accessible for installation and service)

- Please ensure all services are kept within 40" of bottling system. Unless otherwise specified.
- Water shut-off valve to be located at low level. Please ensure that there is sufficient room for a 6 inch long fitting to be connected to the shut-off valve.
- Top of "optional" waste circuit should be located between 12 and 18 inches from ground level.

Insulation:

Please ensure that all water pipes feeding the Vivreau System are correctly insulated to ensure that the water does not heat up within the pipes prior to entering the Vivreau system. This is essential for water quality reasons.


If the system is to be installed in an enclosed space, adequate ventilation must be provided.


For Indoor Use Only

**Female Water Supply
1/2" Threaded Ball Valve**



Bottling System Specifications

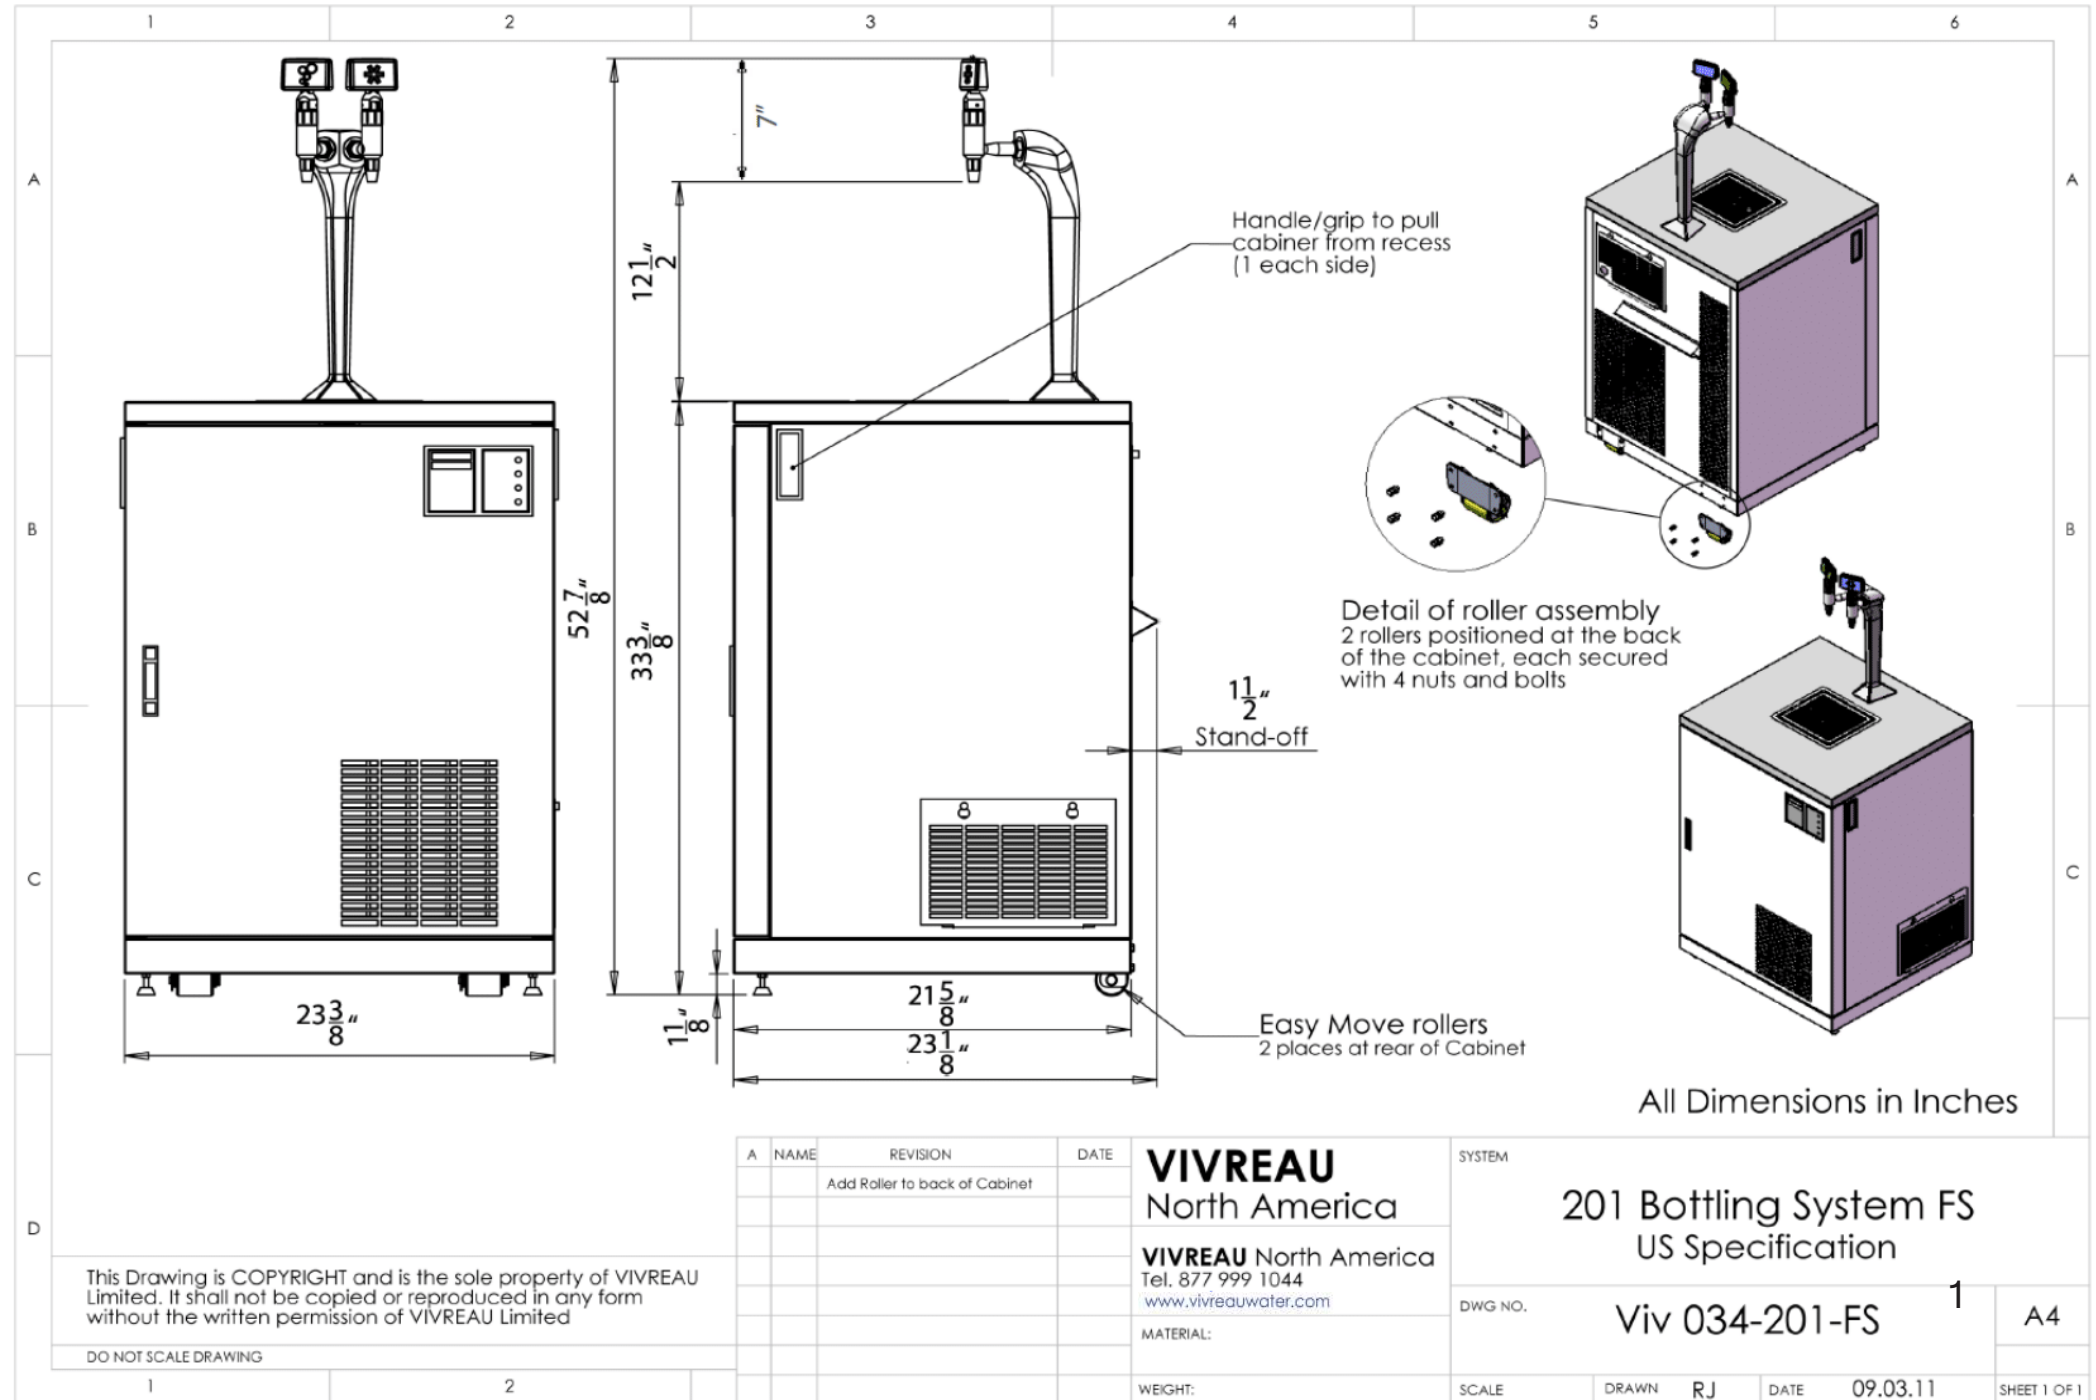

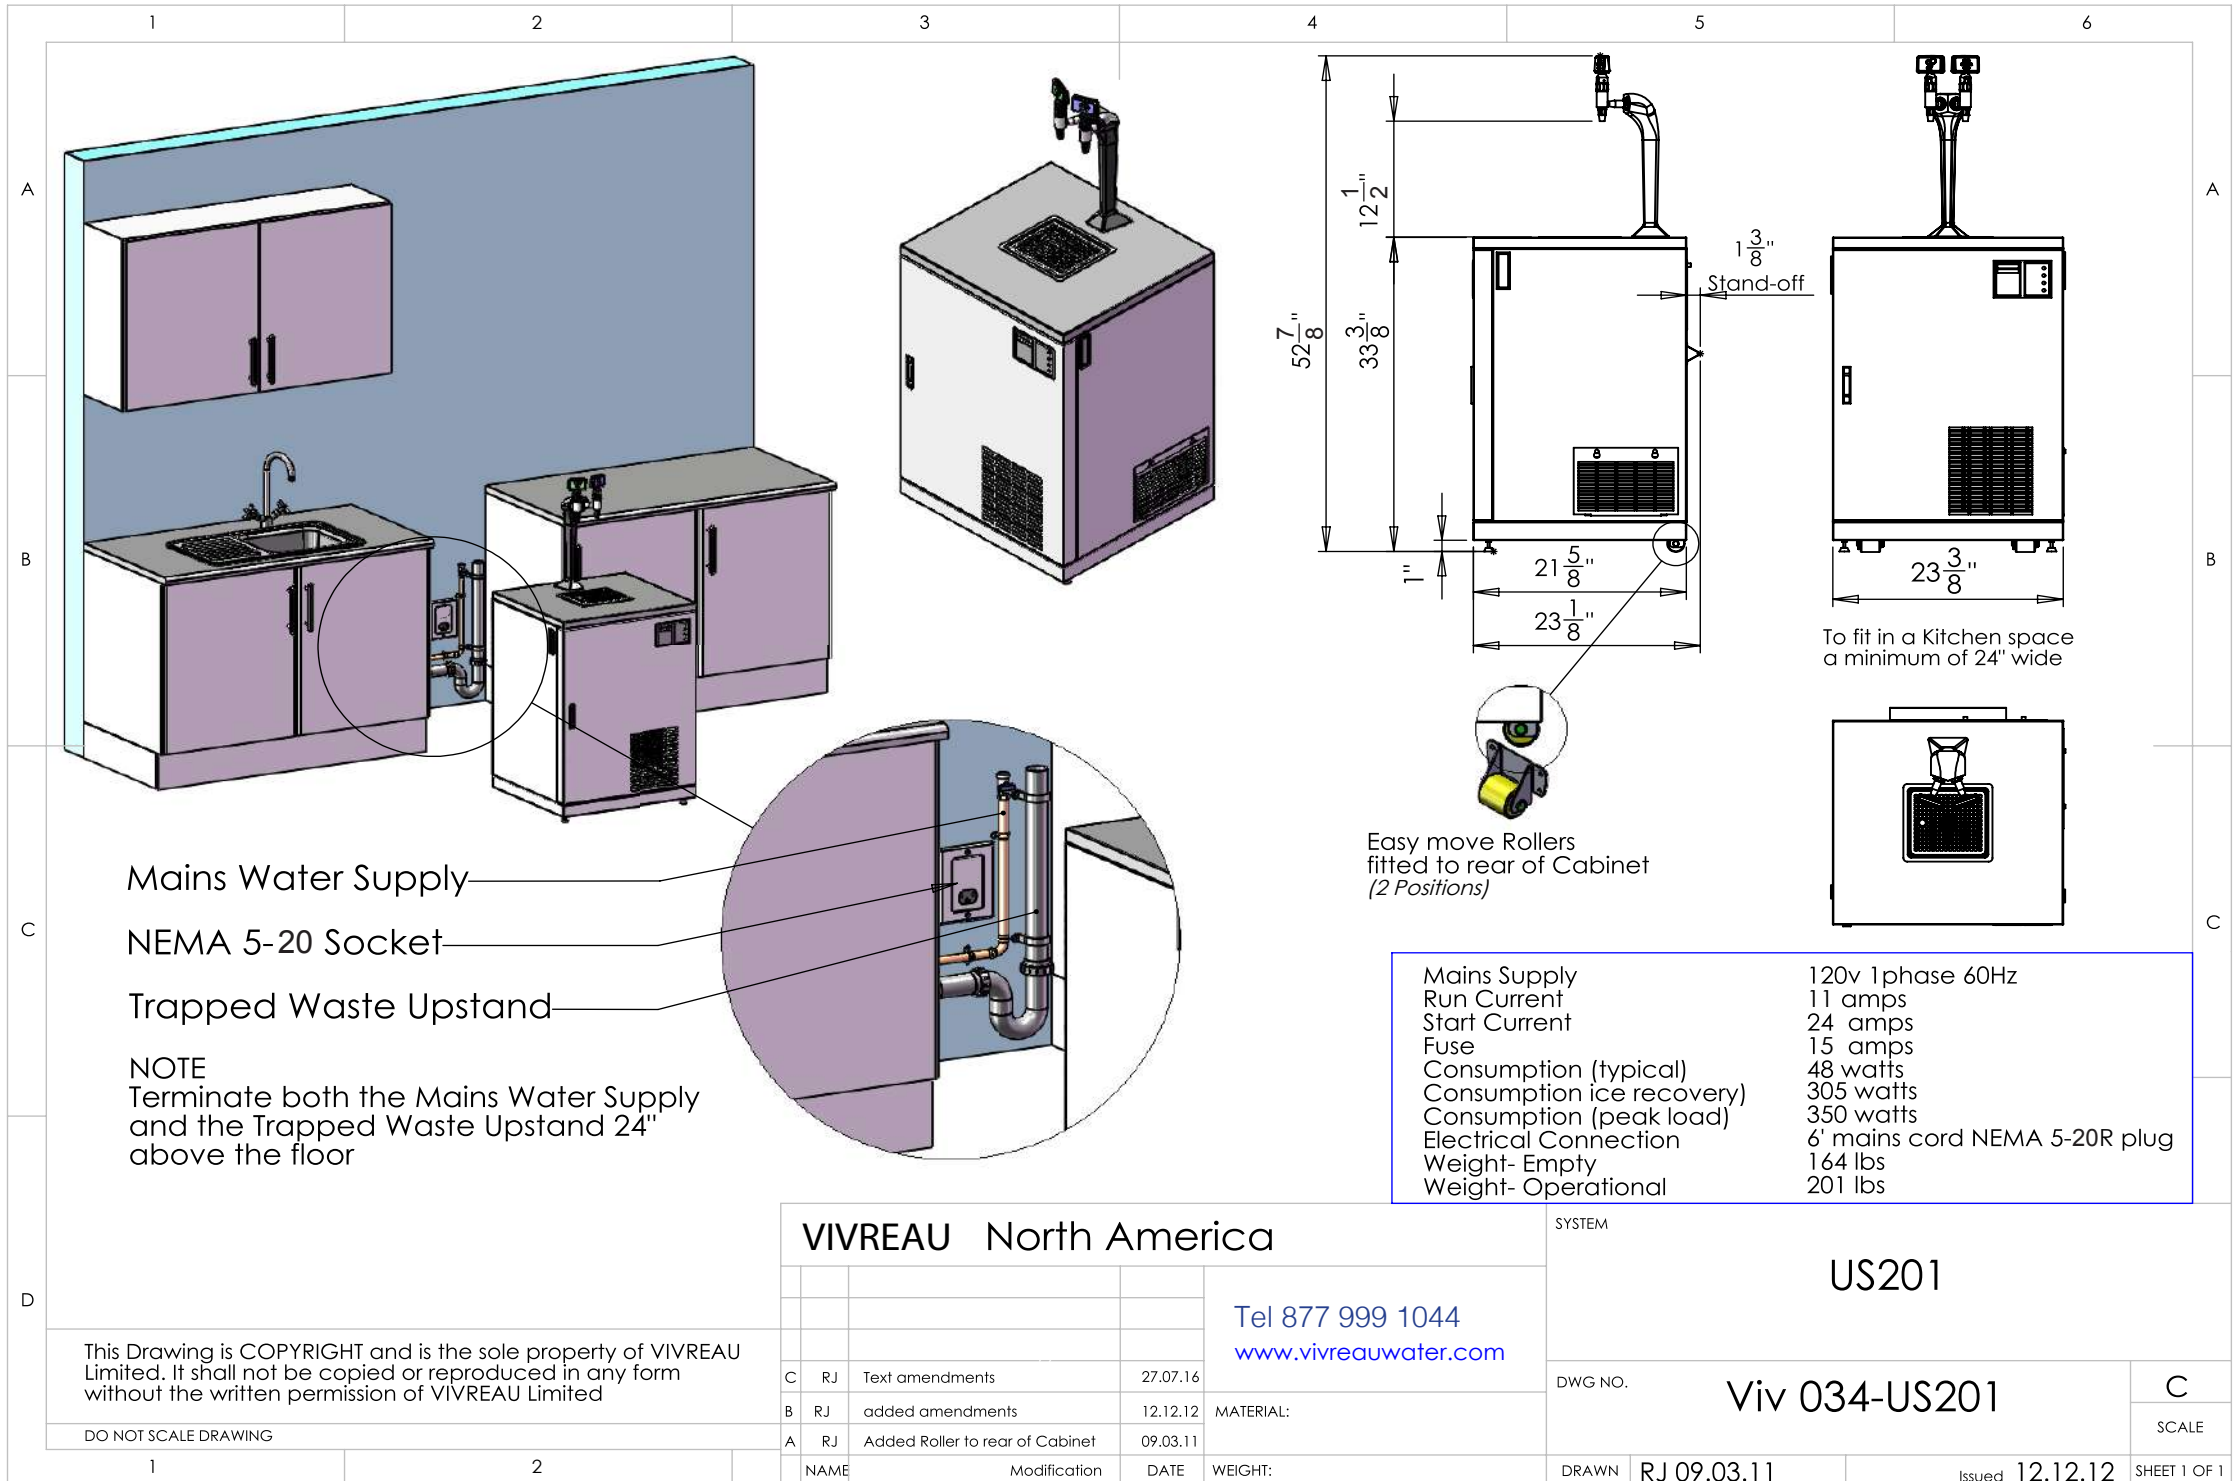

Mains Water Supply

NEMA 5-20 Socket

Trapped Waste Upstand

NOTE
Terminate both the Mains Water Supply
and the Trapped Waste Upstand 24"
above the floor

Mains Supply	120v 1phase 60Hz
Run Current	11 amps
Start Current	24 amps
Fuse	15 amps
Consumption (typical)	48 watts
Consumption (ice recovery)	305 watts
Consumption (peak load)	350 watts
Electrical Connection	6' mains cord NEMA 5-20R plug
Weight- Empty	164 lbs
Weight- Operational	201 lbs

VIVREAU North America

Tel 877 999 1044
www.vivreauwater.com

SYSTEM

US201

This Drawing is COPYRIGHT and is the sole property of VIVREAU Limited. It shall not be copied or reproduced in any form without the written permission of VIVREAU Limited

DO NOT SCALE DRAWING

NAME	Modification	DATE	WEIGHT:
C	RJ	Text amendments	27.07.16
B	RJ	added amendments	12.12.12
A	RJ	Added Roller to rear of Cabinet	09.03.11

MATERIAL:

DWG NO.

Viv 034-US201

C

SCALE

DRAWN

RJ 09.03.11

Issued 12.12.12

SHEET 1 OF 1

VIVREAU[®]

ADVANCED WATER SYSTEMS

Contact Info

Phone Number:

+1 877 999 1044

Email:

InfoUSA@vivreau.com

InfoCanada@vivreau.com

Or visit vivreauwater.com